


© Bechtel Corporation, 2008. All rights reserved. This document is prepared exclusively for Gassnova in connection with any other project. It contains confidential and proprietary information that is confidential and proprietary to Bechtel and may not be used, reproduced, or disclosed in any form without the prior written permission of Bechtel. This document is prepared exclusively for Gassnova in connection with any other project.

E-116  
CO2 COMPRESSOR 3RD STAGE  
STEAM GENERATOR

E-117  
CO2 COOLER

- NOTES:
- FOR STANDARD SYMBOLS, DETAILS AND LEGENDS SEE DRAWINGS M6J-YA-00001 THROUGH M6J-YA-00005.
  - ALL LINES, VALVES, EQUIPMENT, AND INSTRUMENT NUMBERS ARE PREFIXED WITH "QG", UNLESS NOTED OTHERWISE.
  - ALL VENTS, DRAINS AND INSTRUMENTATION ROOT VALVES ARE 1", UNLESS OTHERWISE NOTED.
  - TWO PHASE FLOW.
  - EQUIPMENTS, INSTRUMENTS AND PIPING ASSUMED TO BE INSIDE HEATED BUILDING.

- HOLDS:
- EQUIPMENT VENDOR INFORMATION.
  - CONTROL VALVE (CV) AND PRESSURE SAFETY VALVE (PSV) SIZES.

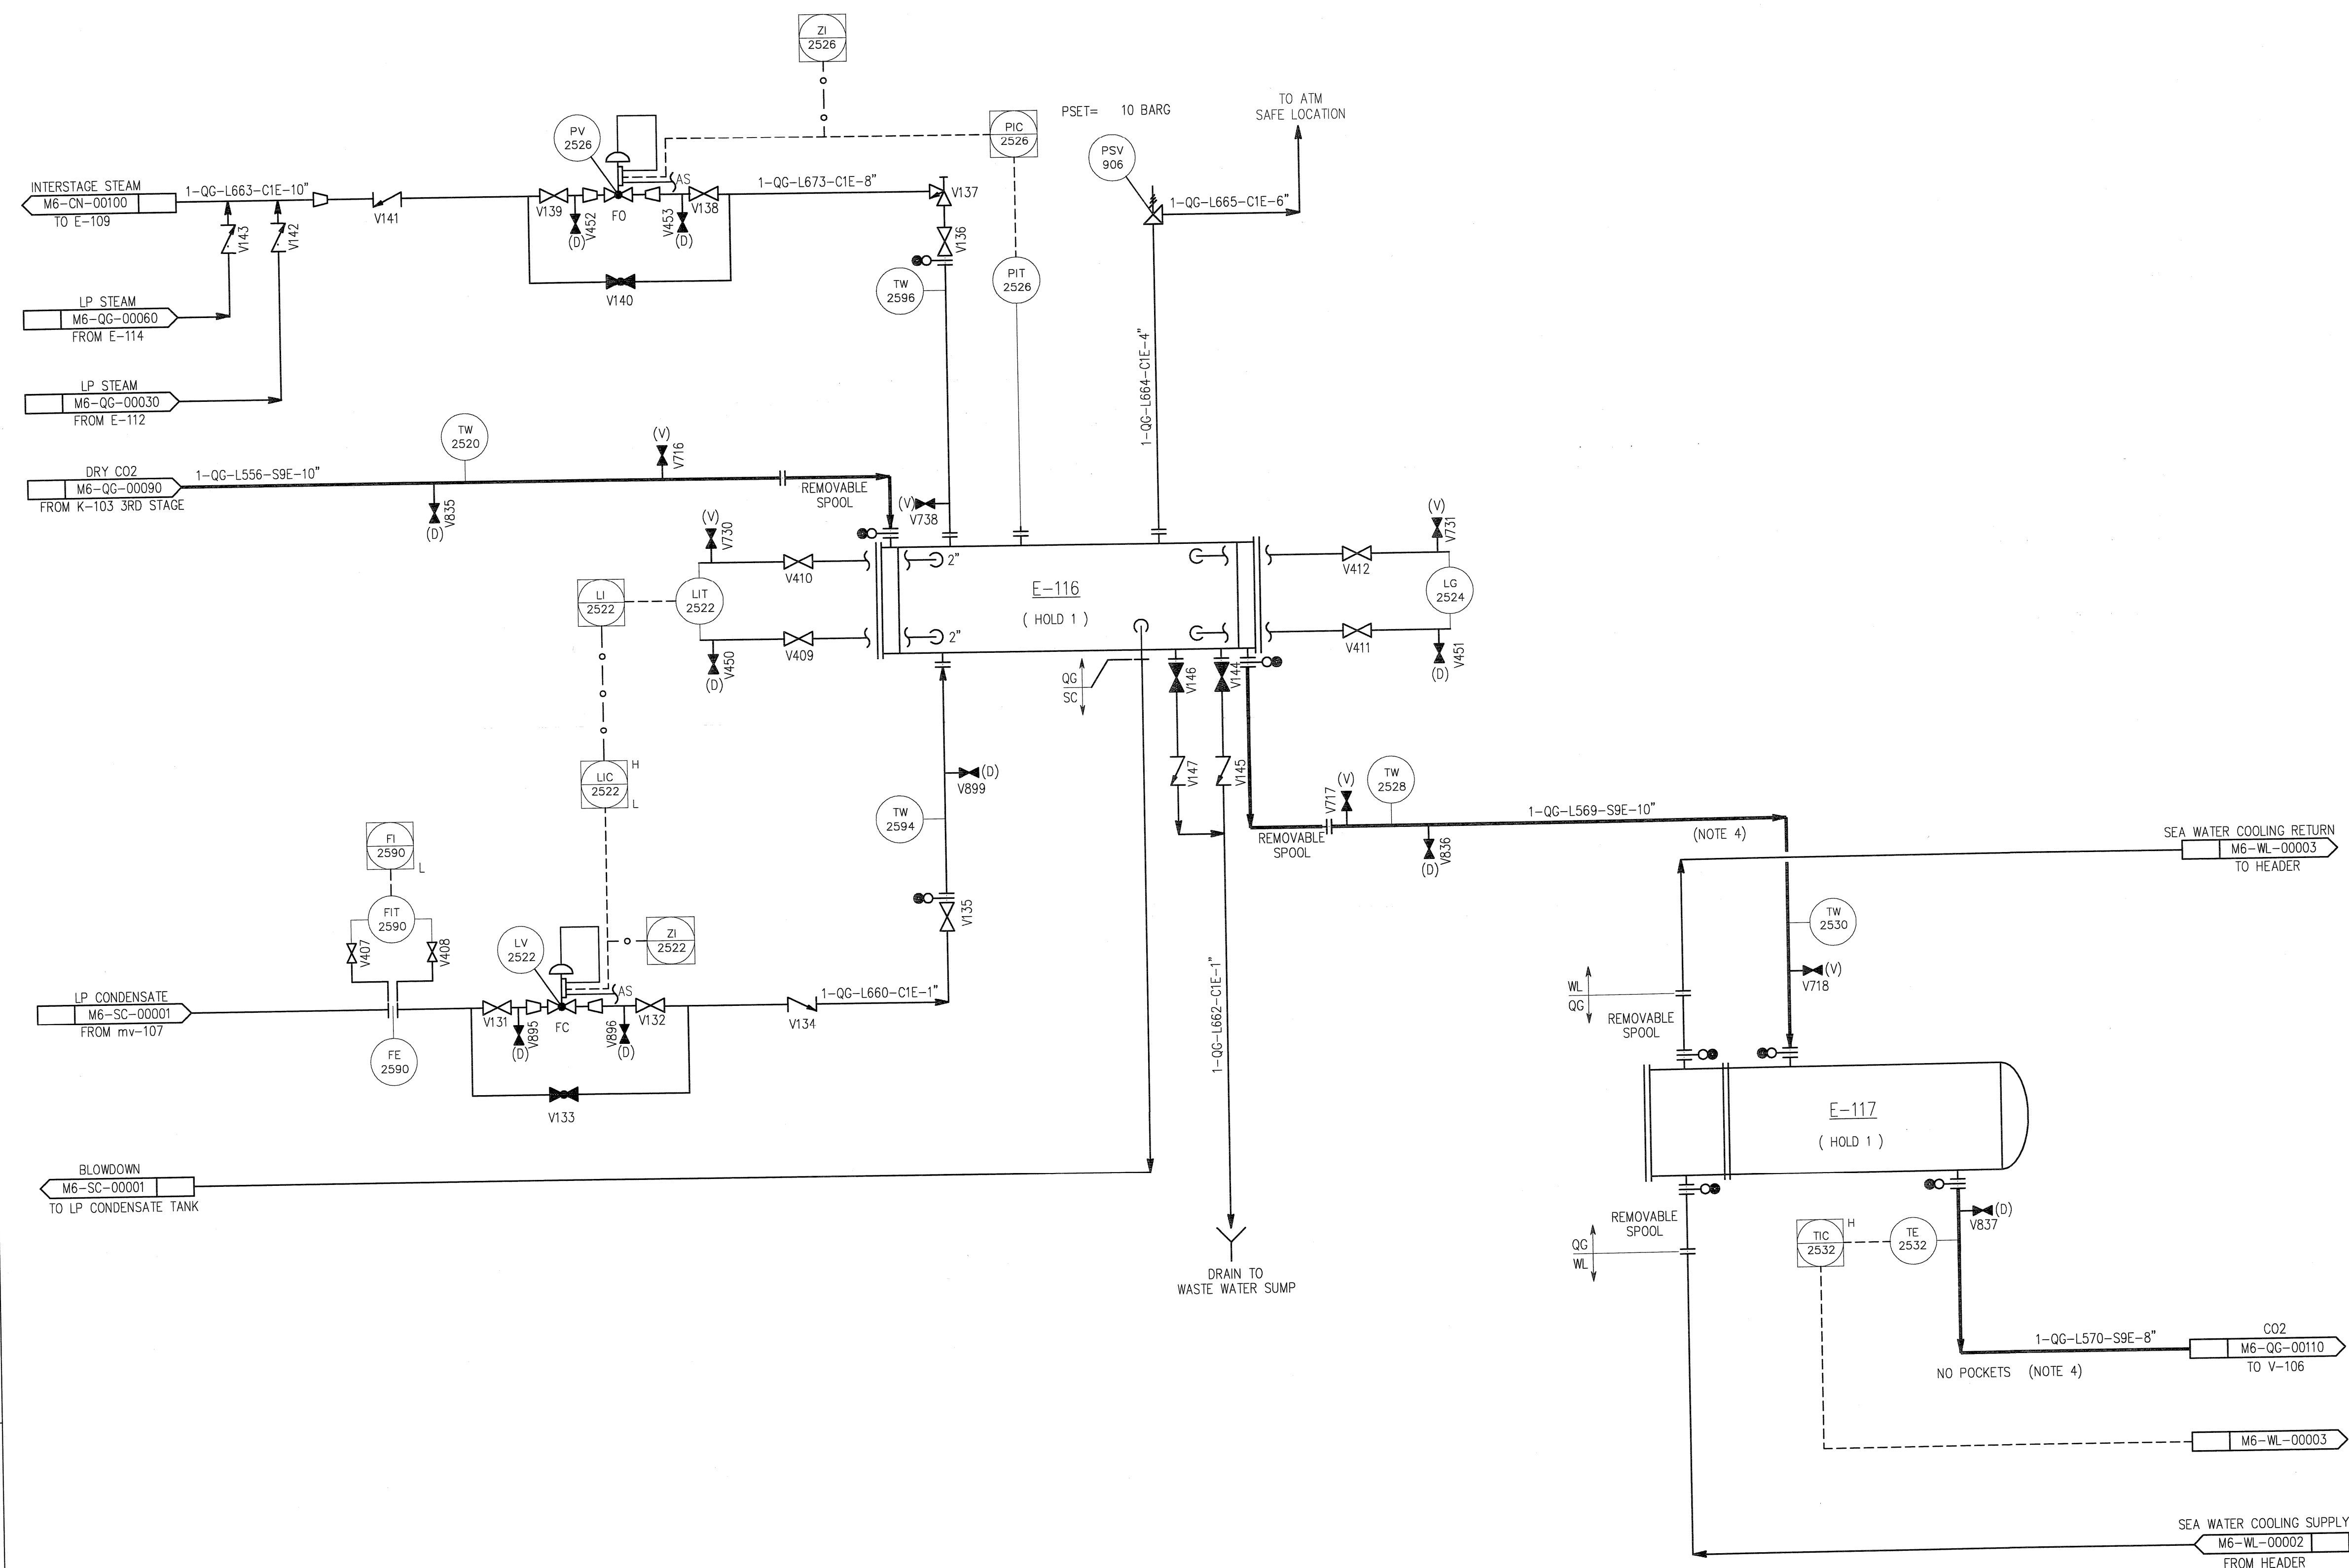

ISSUED FOR APPROVAL		PJ	UP	-	RS	BY	CHK	DES	ENGR.	PROJ	APPR.
NO.	DATE	REVISIONS									
Owner: <b>GASSNOVA</b>		PROJECT: <b>CO2 KARSTO PROJECT</b>									
Drawing No: <b>10112936-PB-P-PID-0041</b>		Description: <b>PIPING &amp; INSTRUMENT DIAGRAM CO2 COMPRESSOR 3RD STAGE STEAM GENERATOR AND INTERCOOLER</b>									
Contractor: <b>BECHTEL POWER CORPORATION</b>		Sheet Size: <b>59x841 A1</b>		Scale: <b>N.T.S.</b>		JOB NO.:		DRAWING NO.:		REV.	
		<b>25474</b>		<b>000-M6-QG-00100</b>		<b>0</b>					