NOTES:

1. FOR SYMBOLS AND LEGENDS SEE DRAWINGS M6J-YA-00001 THROUGH M6J-YA-00005.
2. ALL LINES, VALVES, EQUIPMENT, AND INSTRUMENT NUMBERS ARE PREFIXED WITH "WL", UNLESS NOTED OTHERWISE.
3. ALL VENTS, DRAINS AND INSTRUMENTATION ROOT VALVES ARE 1", UNLESS NOTED OTHERWISE.
4. ✳ SYMBOL INDICATES EQUIPMENT SUPPLIED BY VENDOR.
5. ON LOSS OF AIR OR SOLENOID POWER, VALVE FAILS CLOSED. ON LOSS OF SIGNAL TO POSITIONER, VALVE FAILS AS-IS.
6. VALVES CAPABLE OF THROTTLING SERVICE.
7. AUTOMATIC AIR/VACUUM RELEASE VALVES, AND ISOLATION VALVES, SUPPLIED BY PUMP VENDOR.

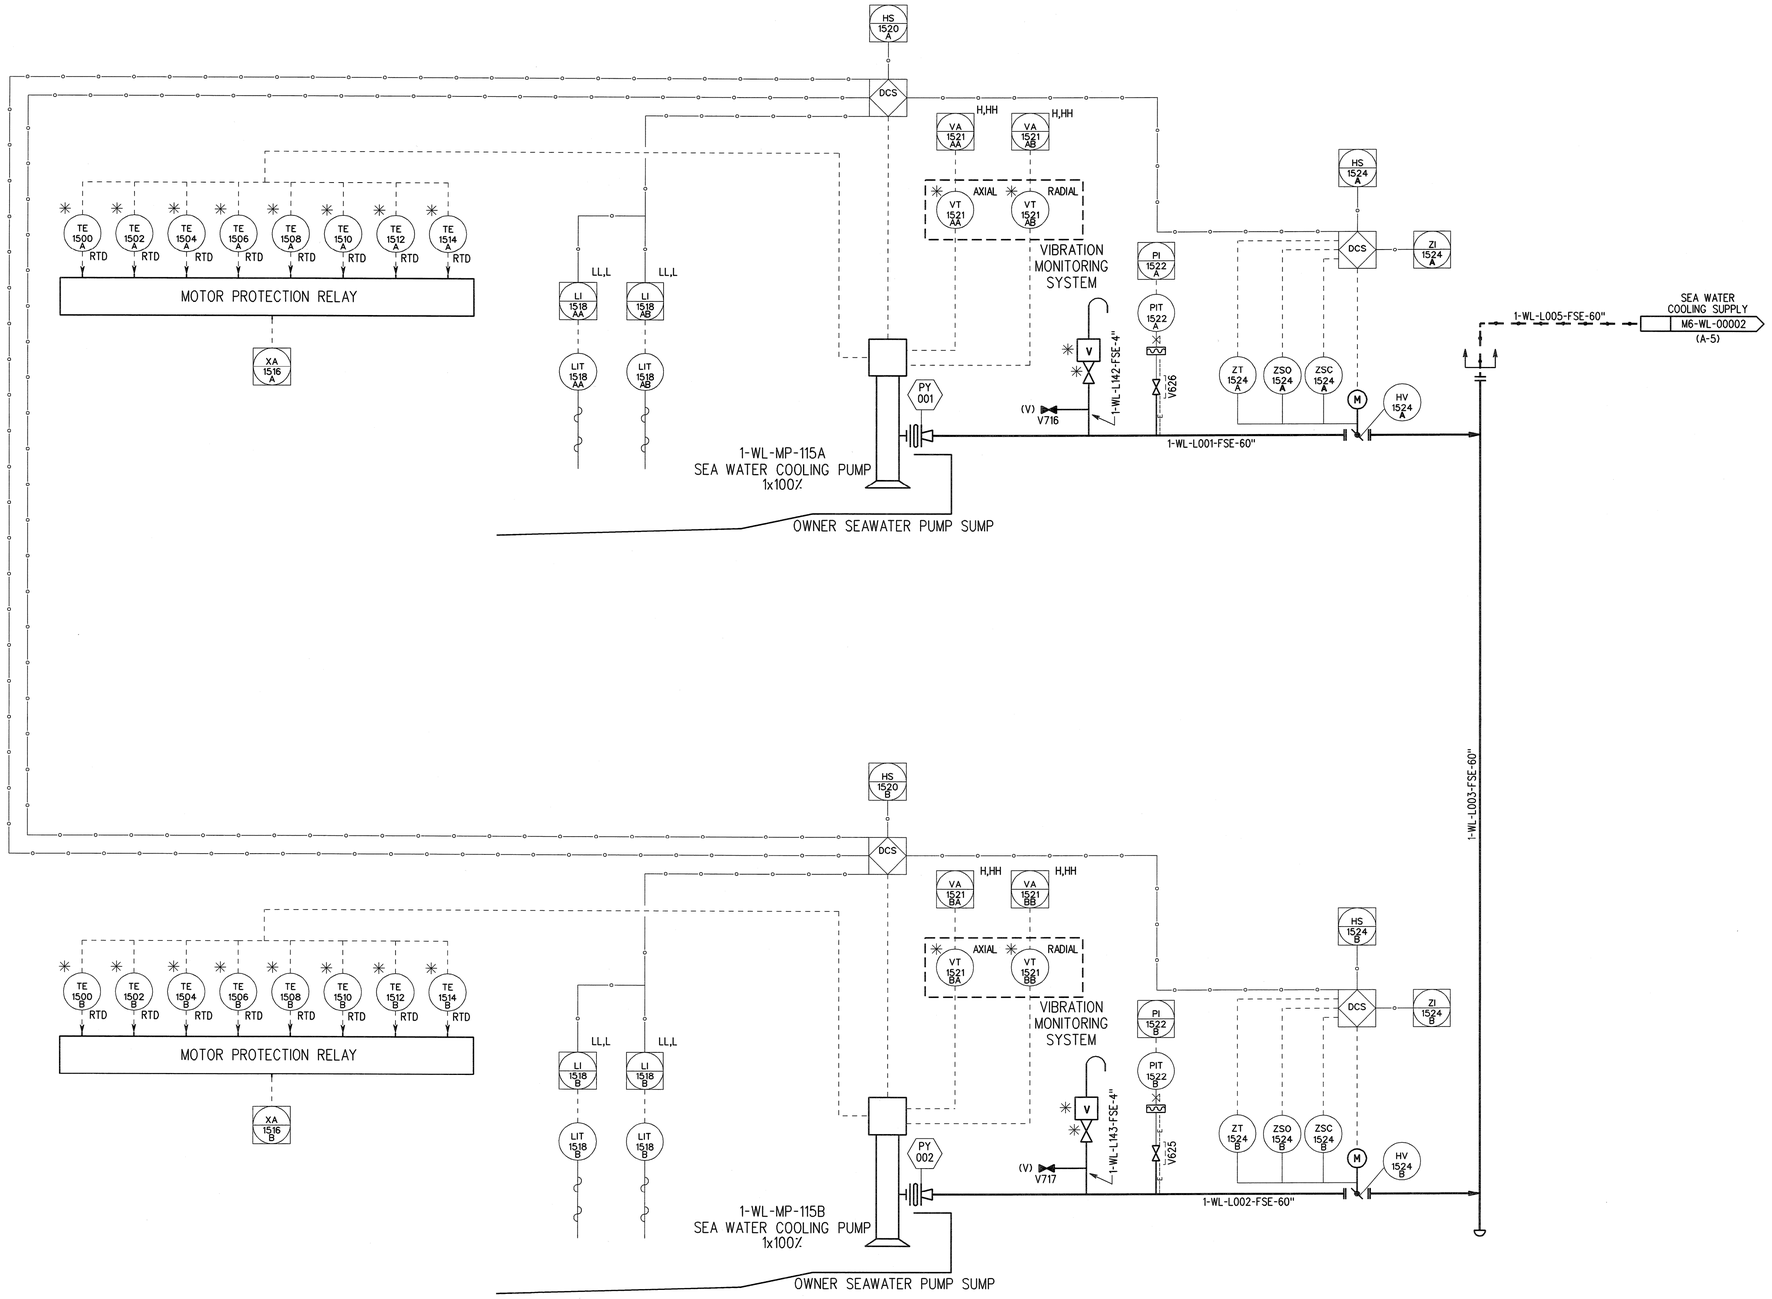

Bechtel Confidential

©BECHTEL POWER CORPORATION 2009. ALL RIGHTS RESERVED. BECHTEL CONFIDENTIAL. CONTAINS INFORMATION THAT IS CONFIDENTIAL AND PROPRIETARY TO BECHTEL AND MAY NOT BE USED, REPRODUCED OR DISCLOSED IN ANY FORMAT WITHOUT BECHTEL'S PRIOR WRITTEN PERMISSION. THIS DOCUMENT IS PREPARED EXCLUSIVELY FOR GASSNOVA IN CONNECTION WITH THE PREPARATION OF THE FEED STUDY FOR THE CO2 CAPTURE FACILITY AT KARSTO, NORWAY, AND IS NOT TO BE RELIED UPON BY OTHERS OR USED IN CONNECTION WITH ANY OTHER PROJECT.

NO.	DATE	REVISIONS	BY	CHK	MECH SUPV	CS SUPV	PD SUPV	PROJ ENGR
0	FEB 09	ISSUED FOR APPROVAL						

SCALE | DESIGNED | DRAWN | PM WZS

BECHTEL POWER CORPORATION
FREDERICK, MARYLAND

CO2 KARSTO PROJECT

PIPING & INSTRUMENT DIAGRAM SEA WATER COOLING SYSTEM

GASSNOVA	OWNER DOCUMENT NUMBER	BECHTEL	JOB NO.	DRAWING NO.	REV
	10112936-PB-P-PID-0054		25474-000	M6-WL-00001	0

22 x 34 "D" SIZE

LEVELS 1 2 3 4 5 6 7 8 9 0 1 2 3 4 5 6 7 8 9 0 1 2 3 4 5 6 7 8 9 0